

SUCF PROJECT NO. 29393  
 CRITICAL MAINTENANCE  
 EXTERIOR ENVELOPE  
 VISUAL ARTS #58


CAMPUS  
 PURCHASE COLLEGE  
 STATE UNIVERSITY OF NEW YORK  
 735 ANDERSON HILL ROAD  
 PURCHASE, NY 10577

CLIENT  
 STATE UNIVERSITY CONSTRUCTION FUND  
 353 BROADWAY  
 ALBANY, NY 12246  
 518.689.2605

ARCHITECT  
 ROBERT SIEGEL ARCHITECTS  
 37 WEST 37th STREET, 12th FLOOR  
 NEW YORK, NY 10018  
 212.921.5600  
 www.robertsiegelarchitects.com

LIGHTING & ELECTRICAL  
 WHITEHOUSE LIGHTING DESIGN  
 4 TENNIS COURT ROAD  
 MAHOPAC, NY 10541  
 914.923.0021

ENVIRONMENTAL  
 ADELAIDE ENVIRONMENTAL HEALTH ASSOCIATES  
 1511 ROUTE 22 SUITE C24  
 BREWSTER, NY 10509  
 845.278.7710

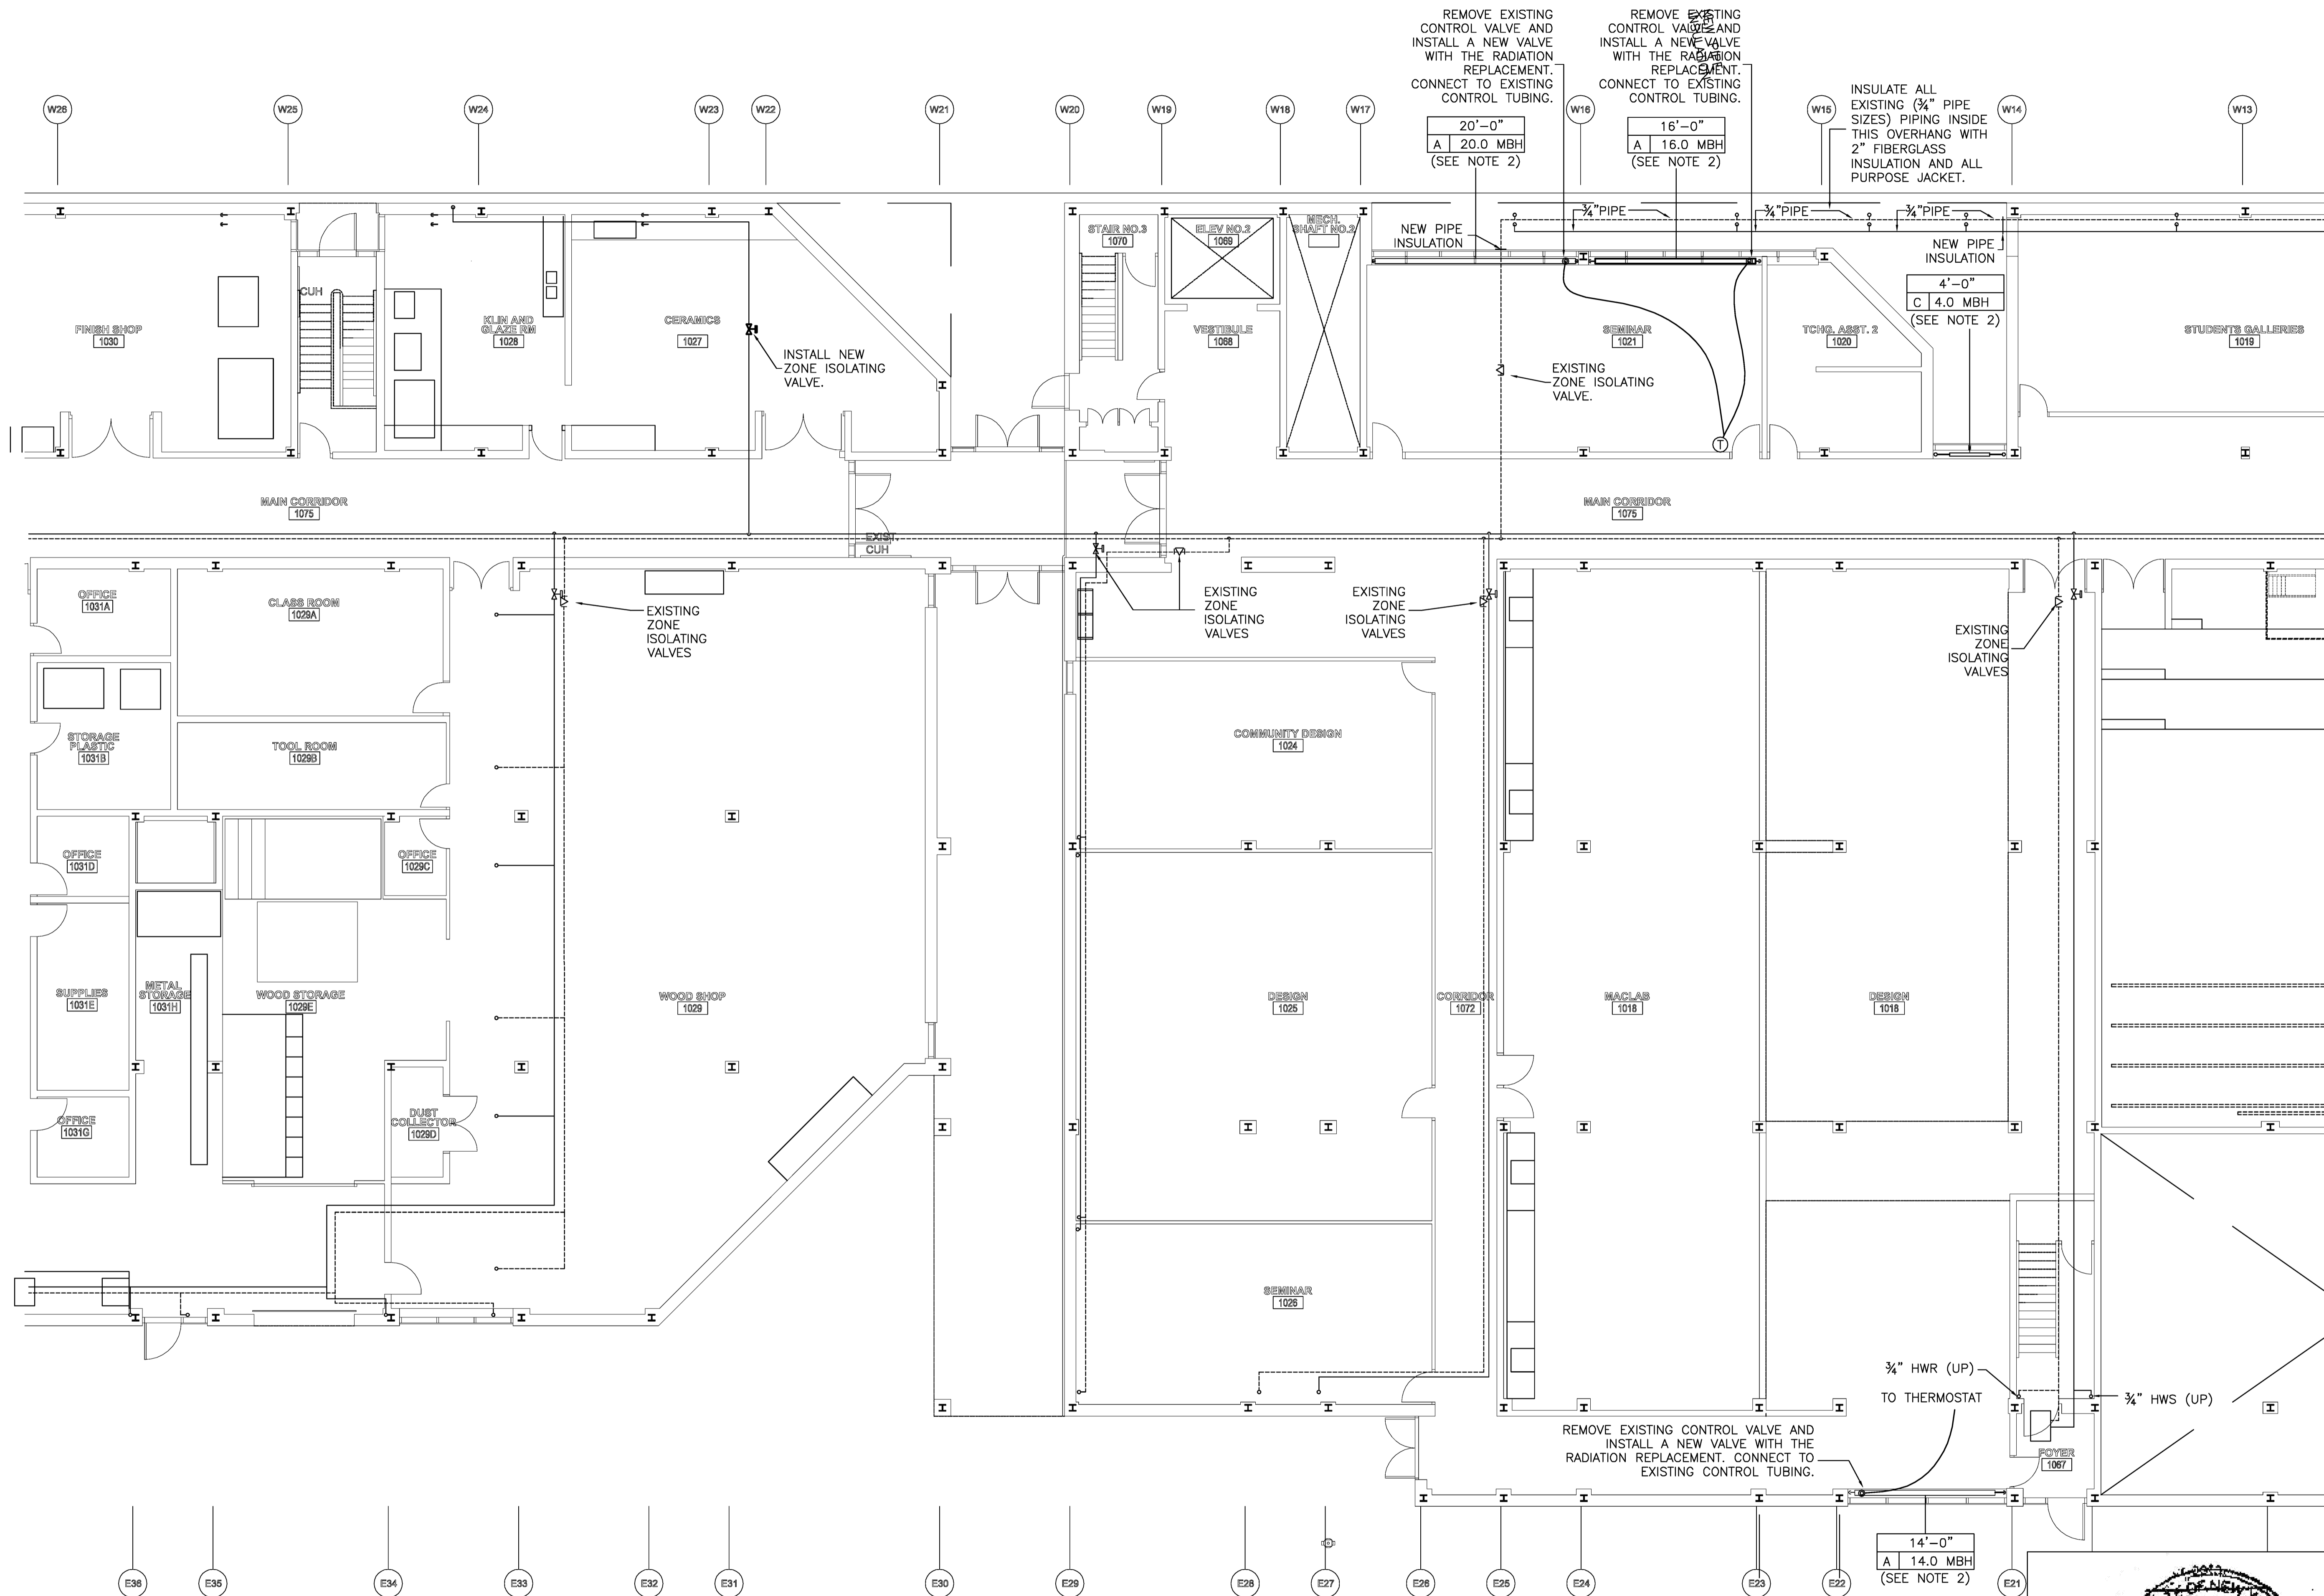


WRITTEN SPECIFICATIONS ARE PART OF THESE DOCUMENTS.



PROJECT 0801  
 DRAWN BY RFB  
 DATE 1.27.2010  
 SCALE 1/8"=1'-0"  
 DRAWING TITLE

LEVEL 1  
 PLAN - MIDDLE

DRAWING NO.  
 M-103

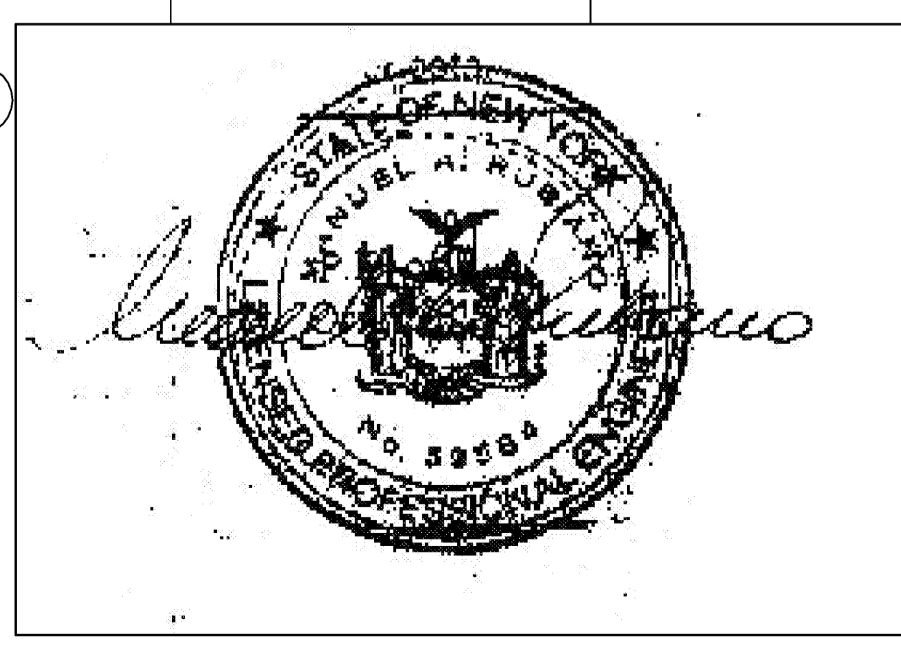

GENERAL NOTES:

1. INSTALL NEW-FIN TUBE RADIATION CONNECTED TO EXISTING PIPING, SEE DETAIL FOR FITTINGS.
2. REMOVE EXISTING FIN-TUBE RADIATION AND CONNECTING PIPING TO EXISTING SHUT OFF VALVES. SHUT-OFF ZONE ISOLATING VALVES TO PREVENT LEAKAGE IN CASE OF DAMAGE OF RADIATION SHUT OFF VALVES. INSTALL NEW FIN-TUBE RADIATION CONNECTED TO EXISTING PIPING, USING NEW FITTINGS AS REQUIRED, AFTER NEW WORK OF WINDOW REPLACEMENT IS COMPLETED. SEE DETAIL FOR FITTINGS REQUIRED.