



NO.	DATE	REVISION
1	11/01/2010	ISSUE FOR CONSTRUCTION
1	11/01/2010	ISSUE FOR BLDG. DEPT.

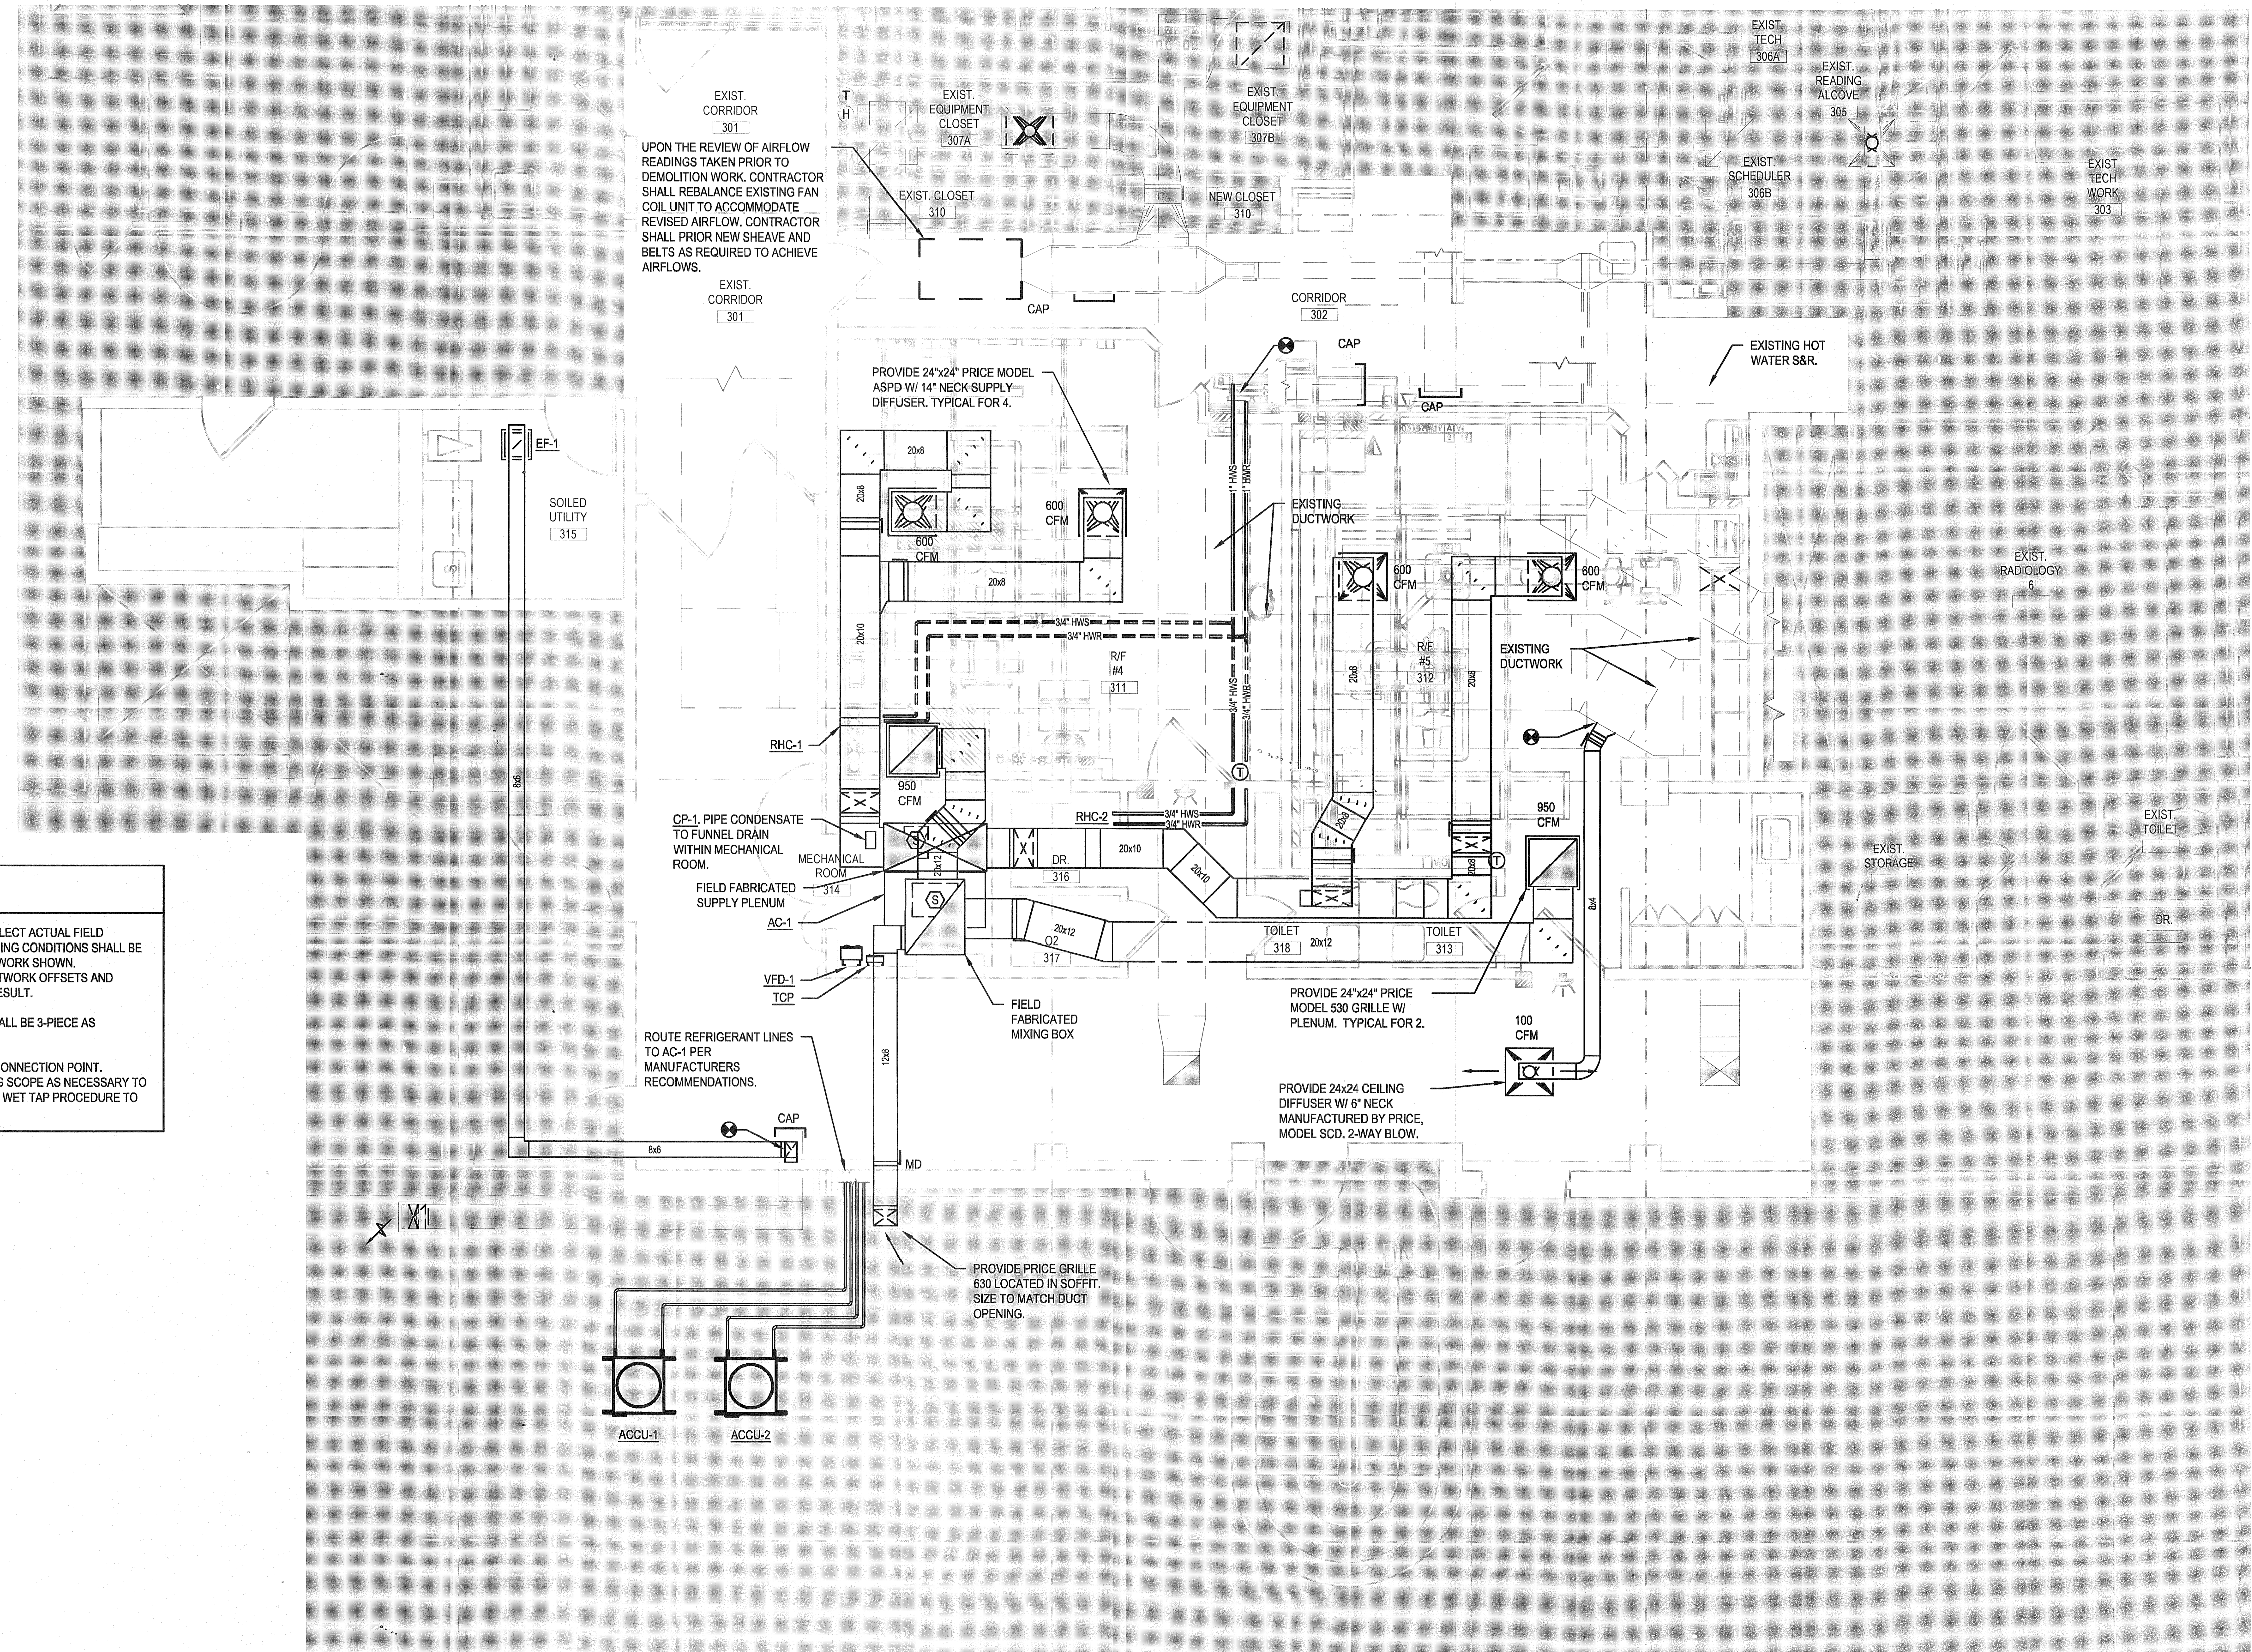

- GENERAL NOTES**
- EXISTING INFRASTRUCTURE SHOWN ON DOCUMENTS MAY NOT REFLECT ACTUAL FIELD CONDITIONS. UPON COMPLETION OF DEMOLITION WORK THE EXISTING CONDITIONS SHALL BE RE-EVALUATED BY THE ENGINEER TO ENSURE ACCURACY OF NEW WORK SHOWN. CONTRACTOR SHALL CARRY AN ALLOWANCE FOR ADDITIONAL DUCTWORK OFFSETS AND MODIFICATIONS TO EXISTING DUCTWORK THAT MAY OCCUR AS A RESULT.
 - ALL BALL VALVES FOR HOT WATER SUPPLY AND RETURN PIPING SHALL BE 3-PIECE AS MANUFACTURED BY APOLLO.
 - DANBURY HOSPITAL TO VERIFY HOT WATER SUPPLY AND RETURN CONNECTION POINT. CONTRACTOR SHALL PROVIDE COST PER LF FOR INCREASED PIPING SCOPE AS NECESSARY TO CONNECT NEW PIPING TO EXISTING MAIN. CONTRACTOR TO UTILIZE WET TAP PROCEDURE TO AVOID ANY SHUT DOWN OF THE HOT WATER SYSTEM.

1 LEVEL 3 FLOOR PLAN
M-100 1/4" = 1'-0"

Perkins Eastman
422 SUMNER STREET
STAMFORD, CT 06901
T: 203.251.7400
F: 203.251.7474

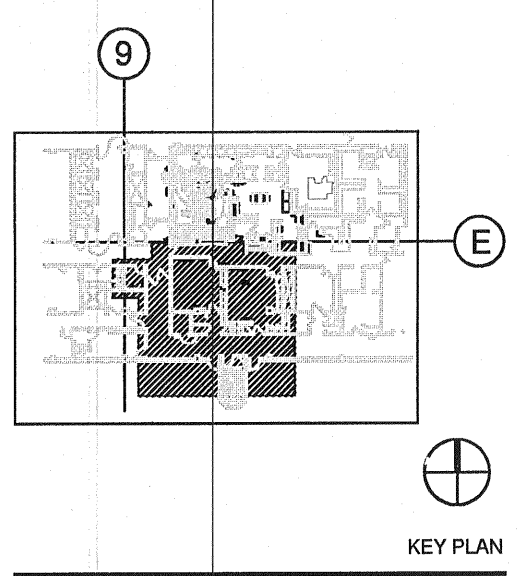

Owner:
Danbury Hospital
A Difference That Matters
DANBURY HOSPITAL
3 TOWER: R/F & ERCP SUITE:
Room 4 & 5
Danbury, Connecticut

MEP:
KOHLEIR RONAN, LLC
301 MAIN STREET
DANBURY, CT
TEL: 203.778.1017
FAX: 203.778.1018
E-MAIL: KRCS@KOHLEIRONAN.COM

Structural:
JOHN SMOLEN & ASSOCIATES, LLC
50 DEVINE STREET, UNIT A
NORTH HAVEN, CT
TEL: (203) 248-0000
FAX: (203) 248-0000
EMAIL: JSA.EM@SINET.NET

RECEIVED
DEC 13 2010
AEM AIR CONDITIONING AND HEATING, INC.

PROJECT TITLE:
**R/F & ERCP SUITE
ROOM 4 & 5
3 TOWER**

24 Hospital Avenue
Danbury, CT

PROJECT No: 41581.00

DRAWING TITLE:
**LEVEL 3 FLOOR
PLAN -
MECHANICAL**

SCALE: 1/4"=1'-0"

M-100
ISSUE FOR CONSTRUCTION
November 1, 2010